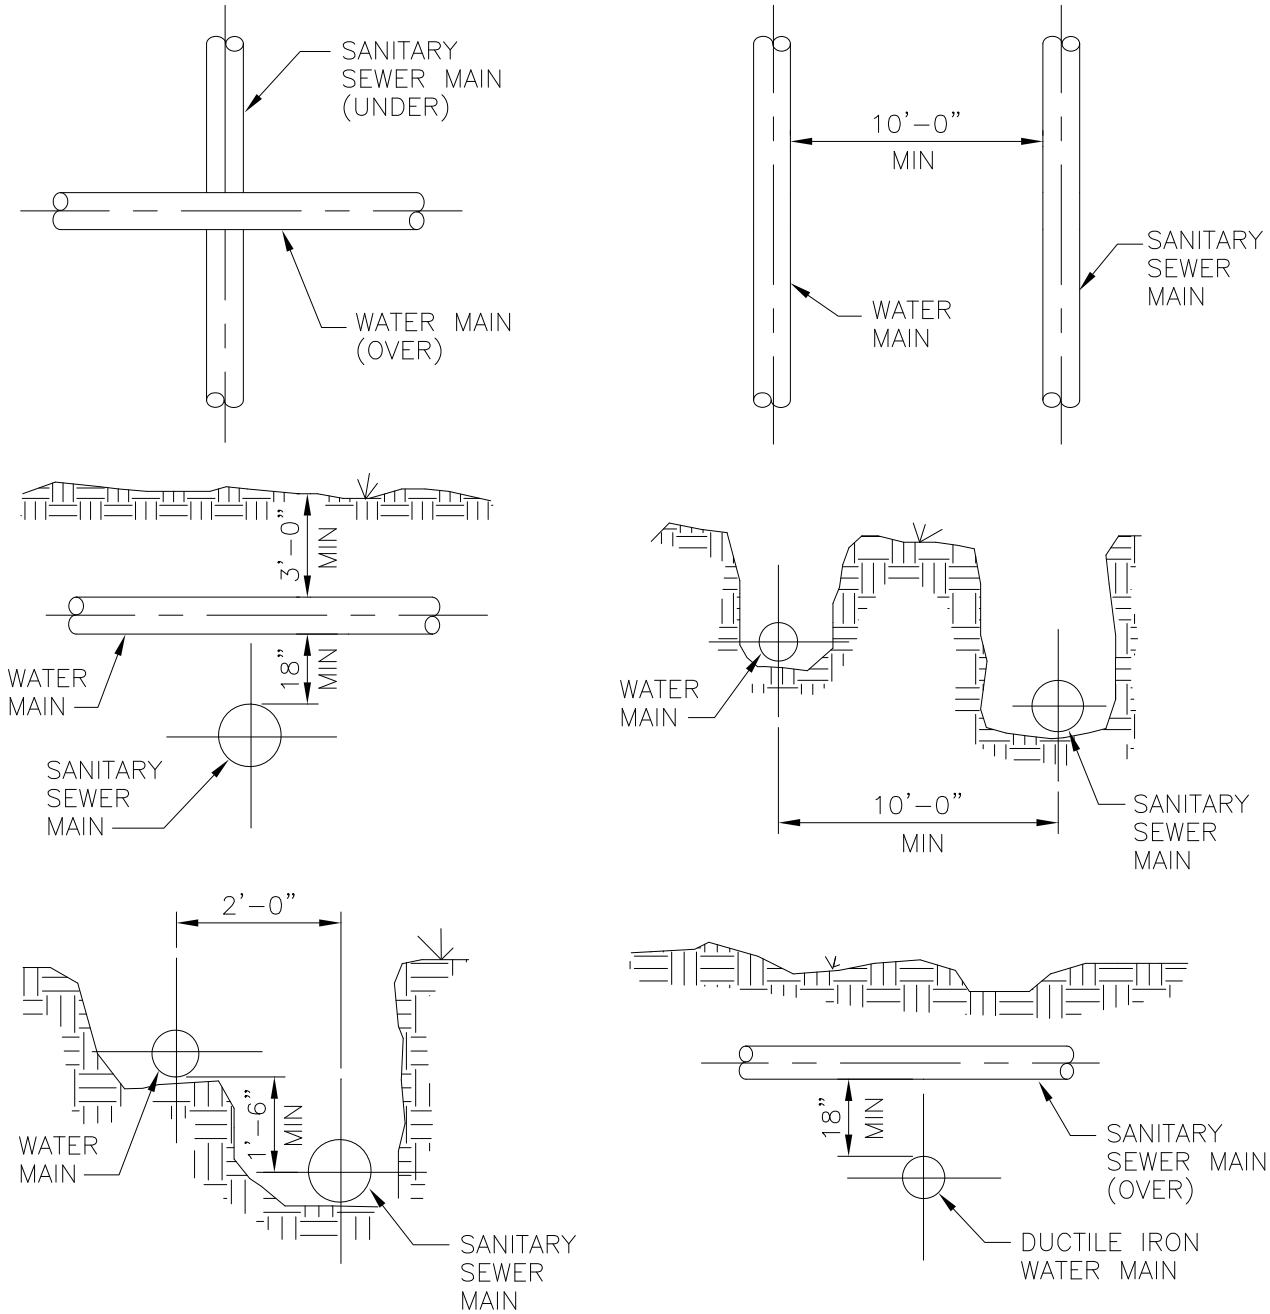

NOTE:

WHEN THE WATER MAIN IS ABOVE THE SANITARY SEWER MAIN, BUT WITH LESS THAN 18" CLEARANCE, OR WHEN THE SANITARY SEWER MAIN IS ABOVE THE WATER MAIN, BOTH THE WATER MAIN AND THE SANITARY SEWER MAIN SHALL BE CONSTRUCTED OF DUCTILE IRON PIPE WITH JOINTS EQUIVALENT TO WATER MAIN STANDARDS FOR A MINIMUM LATERAL DISTANCE, MEASURED AT RIGHT ANGLES TO THE SEWER, OF 10 FEET ON EACH SIDE OF THE CROSSING.

REVISION NO.	DATE	BY	CHKD

WSACC

WATER AND SEWER AUTHORITY OF CABARRUS COUNTY

RELATION OF WATER MAINS TO SANITARY SEWER MAINS

FILE NAME: W3.0

DATE: 8/06