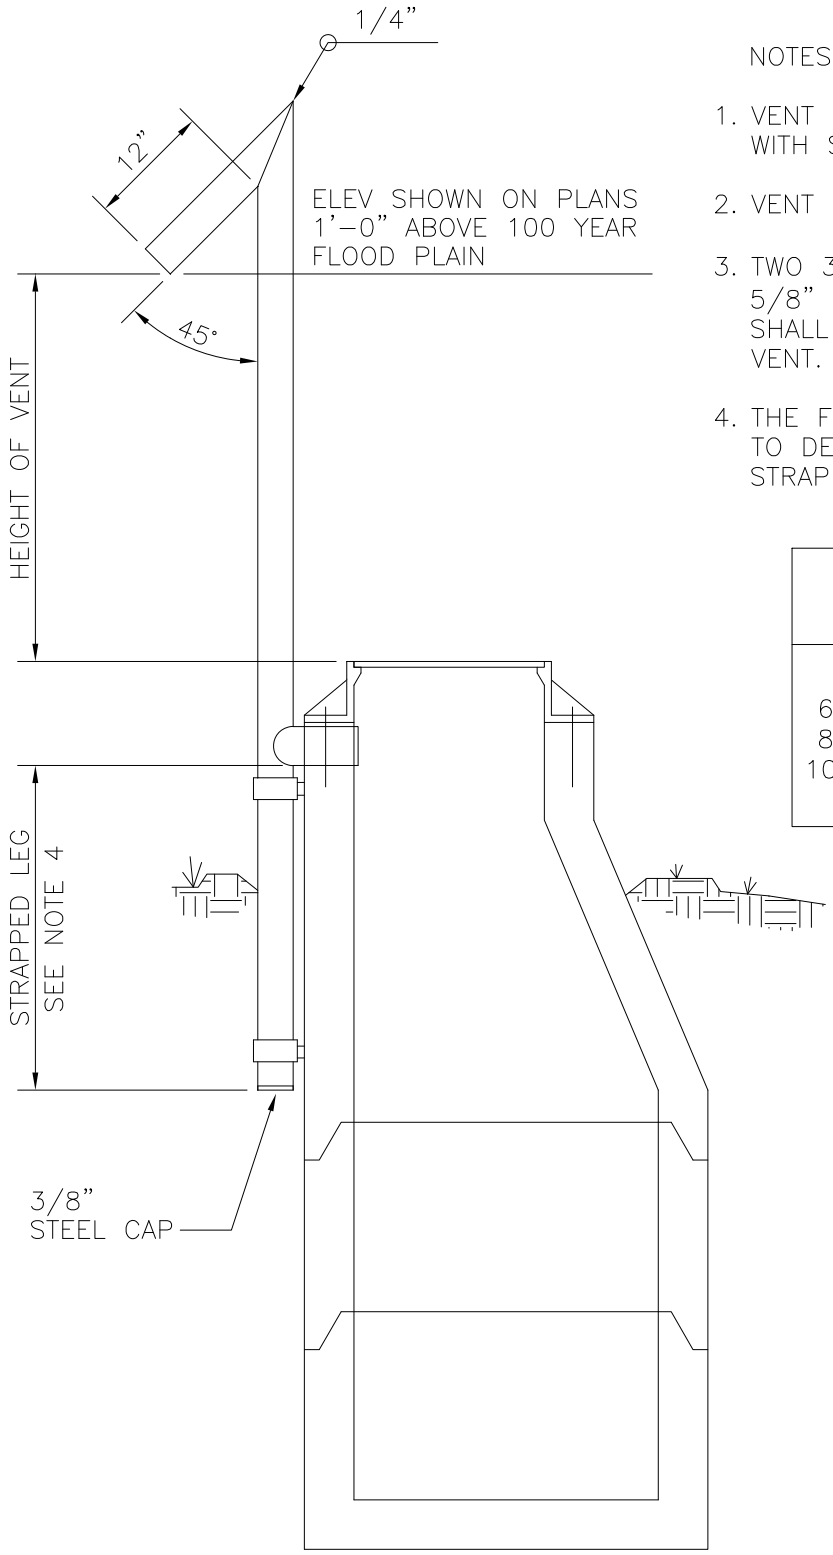

NOTES:

1. VENT PIPE SHALL BE IN ACCORDANCE WITH SPECIFICATION SECTION 02605.
2. VENT OPENING TO POINT DOWNSTREAM
3. TWO 3" X 3/8" STEEL STRAPS, AND 5/8" X 4" EXPANSION ANCHOR BOLTS SHALL BE USED TO SECURELY ANCHOR VENT.
4. THE FOLLOWING TABLE SHALL BE USED TO DETERMINE THE LENGTH OF THE STRAPPED LEG:

HEIGHT OF VENT PIPE	LENGTH OF STRAPPED LEG
UP TO 6.00'	3.00'
6.01' TO 8.00'	4.00'
8.01' TO 10.00'	5.00'
10.01' TO 12.00'	6.00'
OVER 12.01'	7.00'

REVISION NO.	DATE	BY	CHKD

WSACC

WATER AND SEWER AUTHORITY OF CABARRUS COUNTY

STANDARD VENT FOR PRECAST CONCRETE MANHOLE

FILE NAME: S3.0

DATE: 8/06