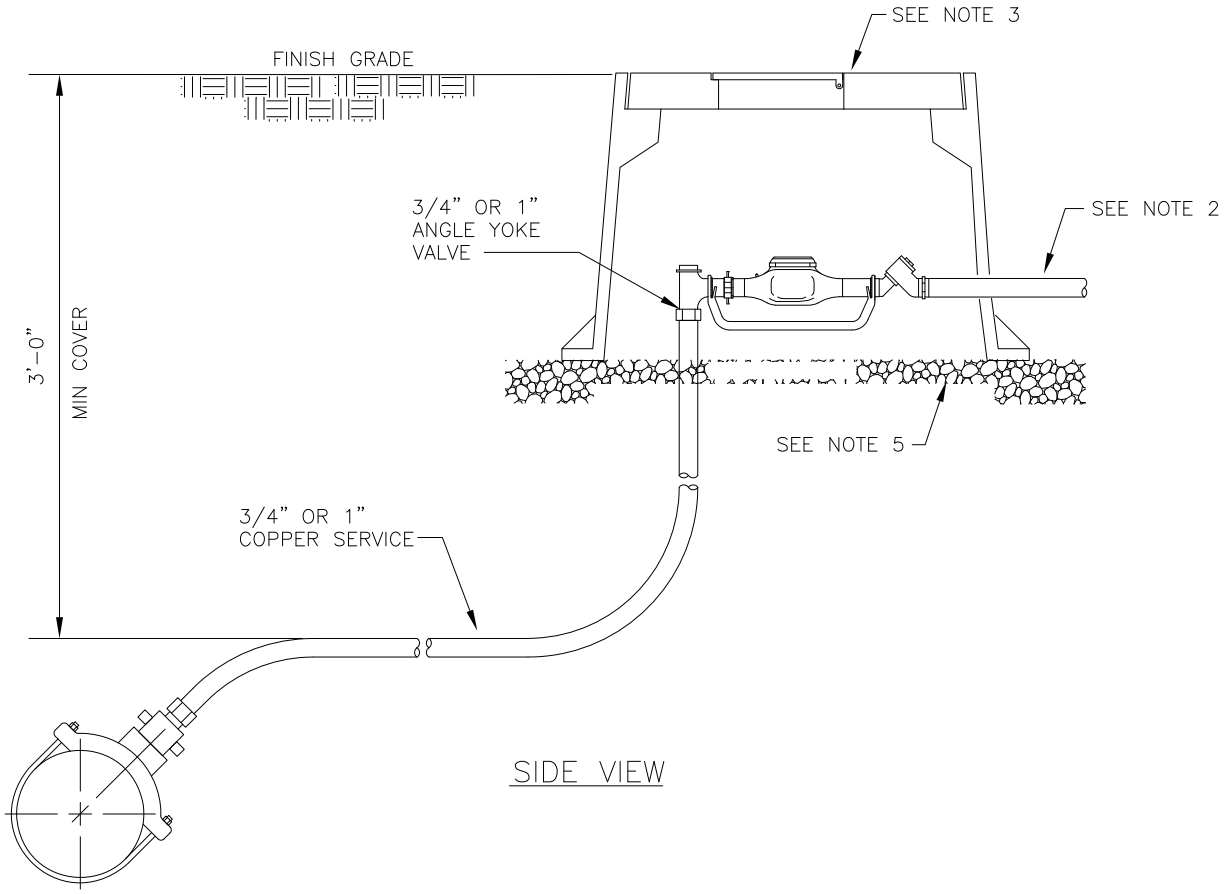

SIDE VIEW

GENERAL NOTES:

1. REFER TO WSACC SPECIFICATIONS FOR ACCEPTABLE MANUFACTURES OF MATERIALS.
2. PROVIDE 12" BRASS NIPPLE PAST BOX.
3. THE METER HOUSING SHALL BE MID STATE PLASTICS OR EQUAL; 3/4–INCH BOX MSBCF – 1118–12XL AND LID MSCBC–1118– RTR; AND 1–INCH BOX MSBCF –1324–12XL AND LID MSCBC–1324– RTR. METER BOX RIM SHALL BE SET FLUSH WITH FINAL GRADE. THE WATER METER BOX ASSEMBLY SHALL NOT BE LOCATED WITHIN A ROAD, STREET, DRIVEWAY, SIDEWALK OR DRAINAGE FEATURE.
4. ALL APPURTENANCES FOR THE INSTALLATION OF THE WATER METER; THE METER, BRASS GROUND LOCKABLE METER CUTOFF, GASKETS, AND EXPANSION CONNECTION; SHALL BE INSTALLED BY THE UTILITY OWNER, UNLESS OTHERWISE SPECIFIED.
5. THE BASE OF THE METER BOX MUST HAVE AT LEAST 6–INCHES TO 8–INCHES OF #57 WASHED STONE.

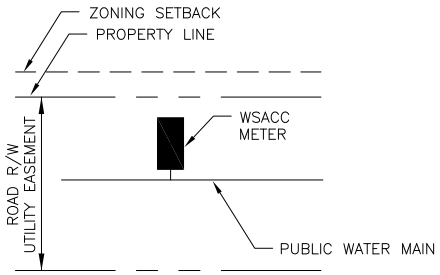

TYPICAL LOCATION REQUIREMENT

REVISION NO.	DATE	BY	CHKD

WSACC

WATER AND SEWER AUTHORITY OF CABARRUS COUNTY

3/4" AND 1" RESIDENTIAL WATER SERVICE METER

FILE NAME: W6.0

DATE: 8/06