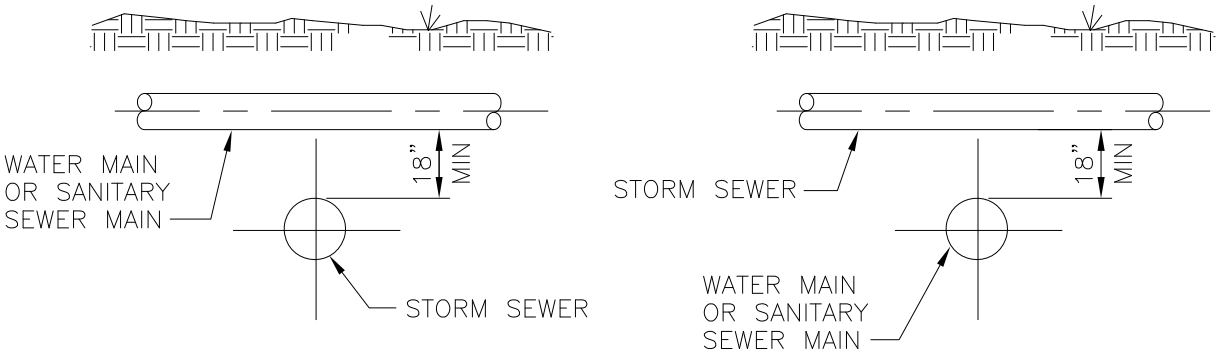

NOTE:

WHEN A WATER MAIN OR SANITARY SEWER MAIN CROSSES OVER OR UNDER A STORM SEWER AND CONDITIONS PREVENT THE REQUIRED 18" MIN VERTICAL SEPARATION, THE WATER MAIN OR SANITARY SEWER MAIN SHALL BE CONSTRUCTED OF DUCTILE IRON PIPE WITH JOINTS EQUIVALENT TO WATER MAIN STANDARDS FOR A MINIMUM DISTANCE OF 10 FEET ON EACH SIDE OF THE POINT OF CROSSING.

REVISION NO.	DATE	BY	CHKD

WSACC

WATER AND SEWER AUTHORITY OF CABARRUS COUNTY

RELATION OF WATER MAINS AND SANITARY SEWER MAINS TO STORM SEWERS

FILE NAME: W4.0

DATE: 8/06